


Heated PDU Instructions



Standard 110V Power Receptacle

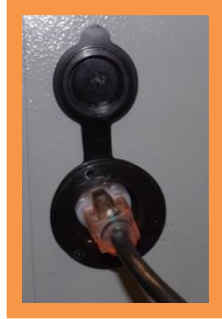

Temperature probe installed.
Temperature control activated at 30°F




Locate the 20 ft. industrial grade extension cord.



Plug the female end of the extension cord in to the standard 110V plug installed in the side of the PDU.



Connect the male end of the extension cord to a standard 110V power source.

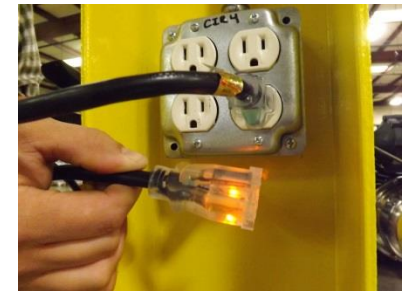

The extension cord has an illuminated female end that will easily identify that the heated PDU is operational. The installed heating control system will automatically activate when ambient temperatures are at 30° F or below.

Heating equipment is certified as operational prior to shipping.